


PLAN VIEW

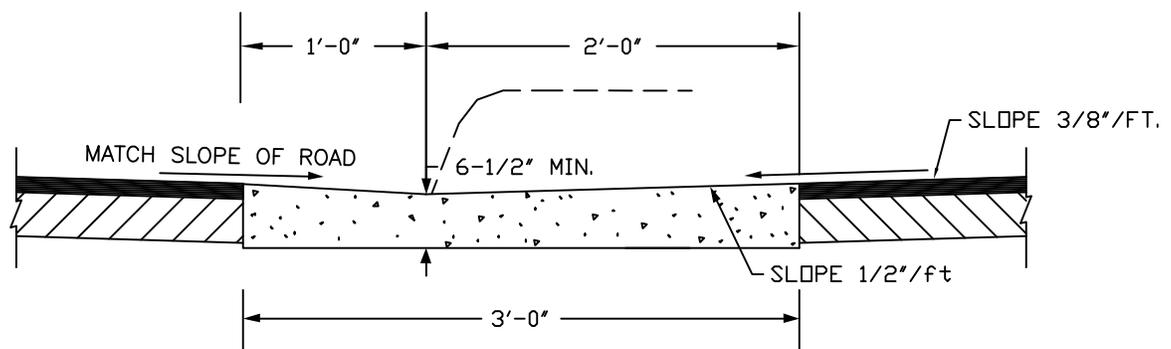

SECTION A - A

NOTES:

1. WHERE SPECIFIED, DEPRESS THE CURB FOR INSTALLATION OF ADA COMPLIANT CURB RAMPS PER CITY PAVING DETAIL P06. WHERE A SIDEWALK CROSSES AT THE DRIVEWAY THERE MUST BE A 4' WIDE ACCESSIBLE PATH WITH NO MORE THAN 2% CROSS-SLOPE BETWEEN THE CURB RAMPS PER GA CODE 120-3-20-14(7).
2. COMPACT BASE AND SUB-BASE TO 100% STANDARD (ASTM D-698) PER SECTION 02200, PART 3.01B OF CITY TECHNICAL SPECIFICATIONS.
3. CONCRETE IN THE ROW TO BE 5000PSI PER SECTION 03300, CHAPTER 3.2 AND REINFORCED WITH FIBERMESH OR STEEL PER SECTION 3300, CHAPTER 5 OF CITY TECHNICAL SPECIFICATIONS.
4. ALL PAVEMENT AND CONCRETE CUTS MUST BE STRAIGHT, SAWCUT LINES.

STANDARD CONSTRUCTION
DETAILS



CONCRETE SWALE WITH FILLETS

PLATE NUMBER:

P04

APPROVED:

SIGNATURE ON FILE
CITY ENGINEER

SCALE: N.T.S.

DATE: FEBRUARY 2009