
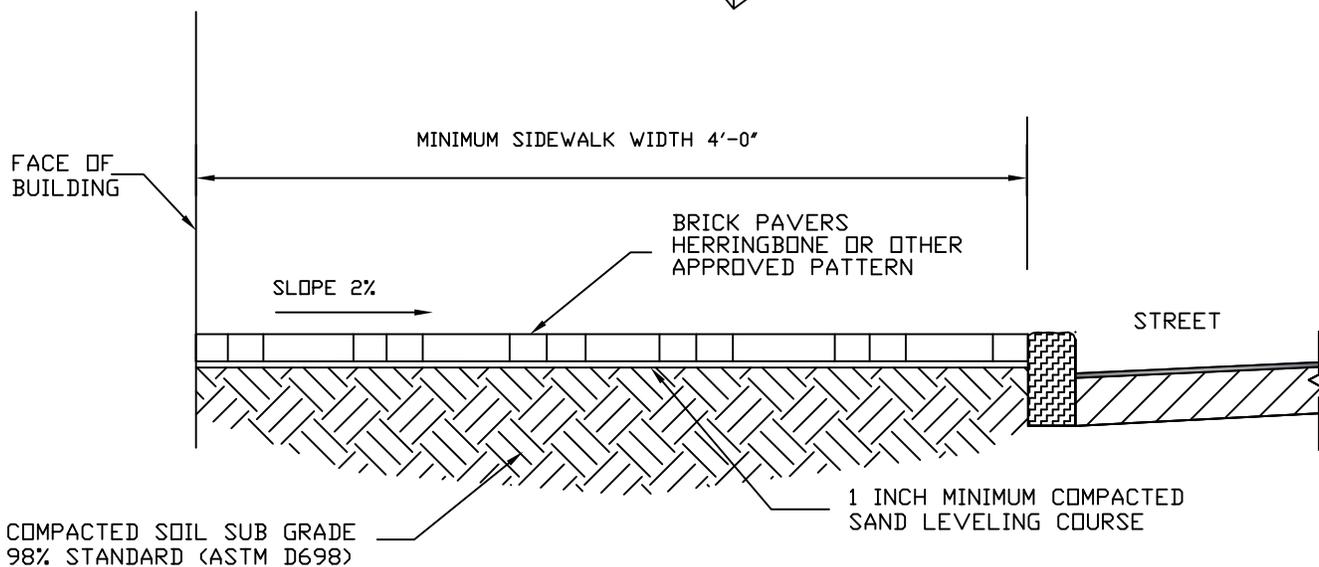


SIDEWALK PATTERN  
ISOMETRIC

BRICK PAVERS  
(SEE SPECIFICATION IN NOTES)



SECTION

NOTES:

1. BRICKS SHOULD BE PINE HALL FLASH RED OR EQUAL AND SHALL CONFORM TO ASTM C902. BRICK SHALL BE UNIFORM IN SIZE, MEASURING 4 INCHES IN WIDTH, 8 INCHES IN LENGTH, WITH A DEPTH OF 2 ¼ INCHES. THE BRICK PAVERS SHALL BE LAID IN A HERRINGBONE OR OTHER APPROVED PATTERN. ANY EXPOSED CONCRETE HEADER CURB MUST BE TINTED PER CITY SPECIFICATIONS.
2. ALL CONSTRUCTION SHALL CONFORM TO ANY APPLICABLE CITY OF SAVANNAH DEVELOPMENT GUIDELINES INCLUDING SECTION 02200 EARTHWORK, SECTION 03300 CAST-IN-PLACE CONCRETE AND SECTION 02605 BRICK ON SAND SIDEWALK TECHNICAL SPECIFICATIONS.
3. IN AREAS WHERE SIDEWALKS ARE WITHIN CRITICAL ROOT ZONES OF TREES, USE THE FOLLOWING: AMOCD GEOTEXTILE 2016 OR EQUAL REINFORCEMENT FABRIC INSTALLED BETWEEN SUBGRADE AND SAND LEVELING COURSE, FOLLOWED BY FILTER FABRIC (AMOCD GEOTEXTILE 2002 OR EQUAL).
4. ADA COMPLIANT WHEELCHAIR RAMPS SHALL BE INSTALLED AT EACH INTERSECTION OR DESIGNATED CROSSWALK LOCATION AND MUST MEET THE MOST CURRENT ADA STANDARDS AND CITY OF SAVANNAH SPECIFICATIONS AT THE TIME OF CONSTRUCTION.

STANDARD CONSTRUCTION  
DETAILS



SIDEWALK—BRICK ON SAND DETAIL

PLATE NUMBER:

P09A

APPROVED:

SIGNATURE ON FILE

CITY ENGINEER

SCALE: N.T.S.

DATED: FEBRUARY 2009