
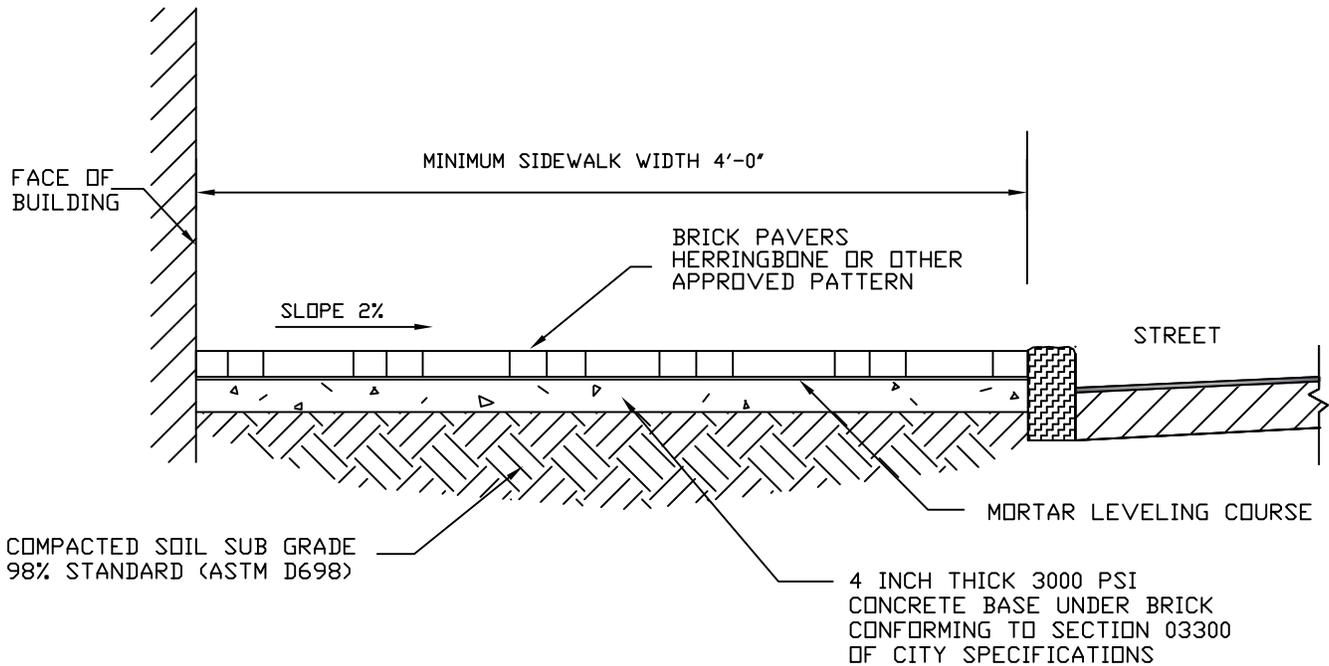


SIDEWALK PATTERN
ISOMETRIC

BRICK PAVERS
(SEE SPECIFICATION IN NOTES)



NOTES

1. BRICKS SHOULD BE PINE HALL FLASH RED OR EQUAL AND SHALL CONFORM TO ASTM C902. BRICK SHALL BE UNIFORM IN SIZE, MEASURING 4 INCHES IN WIDTH, 8 INCHES IN LENGTH, WITH A DEPTH OF 2-1/4 INCHES. THE BRICK PAVERS SHALL BE LAID IN A HERRINGBONE OR OTHER APPROVED PATTERN. ANY EXPOSED CONCRETE HEADER CURB MUST BE TINTED PER CITY SPECIFICATIONS.
2. ALL CONSTRUCTION SHALL CONFORM TO THE CITY OF SAVANNAH DEVELOPMENT GUIDELINES AND TECHNICAL SPECIFICATIONS INCLUDING, BUT NOT LIMITED TO, SECTION 02200 - EARTHWORK, SECTION 03300 - CAST-IN-PLACE CONCRETE AND SECTION 02605 - SIDEWALK- BRICK ON SAND.
3. ADA COMPLIANT WHEELCHAIR RAMPS SHALL BE INSTALLED AT EACH INTERSECTION OR DESIGNATED CROSSWALK LOCATION AND MUST MEET OR EXCEED THE MOST CURRENT ADA STANDARDS AND CITY OF SAVANNAH SPECIFICATIONS AT THE TIME OF CONSTRUCTION.

STANDARD CONSTRUCTION
DETAILS



SIDEWALK-BRICK ON CONCRETE DETAIL

PLATE NUMBER:

P09B

APPROVED:

SIGNATURE ON FILE

CITY ENGINEER

SCALE: N.T.S.

DATED: FEBRUARY 2009