


PROFILE

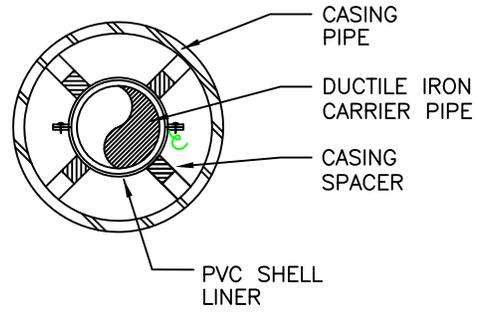

SECTION A-A

NOTES:

1. CASING SPACERS SHALL BE PLACED ON 6' CENTERS MAXIMUM.
2. ALL RAILROAD CROSSINGS SHALL BE INSTALLED IN ACCORDANCE WITH AMERICAN RAILWAY ENGINEERING ASSOCIATION REGULATIONS, UNDER PART 5, PIPELINES (LATEST EDITION) AND PERMIT REQUIREMENTS.
3. ALL HIGHWAY CROSSINGS SHALL BE INSTALLED IN ACCORDANCE WITH GA. D.O.T. REGULATIONS & PERMIT REQUIREMENTS.
4. COPPER COATED STEEL TRACER WIRE MUST BE INSTALLED ON PIPE.

STEEL CASING INSTALLATION

STANDARD
CONSTRUCTION
DETAILS



CITY OF
savannah
WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.
DATED: JAN 2017
PLATE NUMBER:
S9A