



NOTE:

STAINLESS STEEL LINK SEAL (WALL SLEEVE) CONNECTIONS ARE REQUIRED FOR VALVE PITS & WETWELLS.

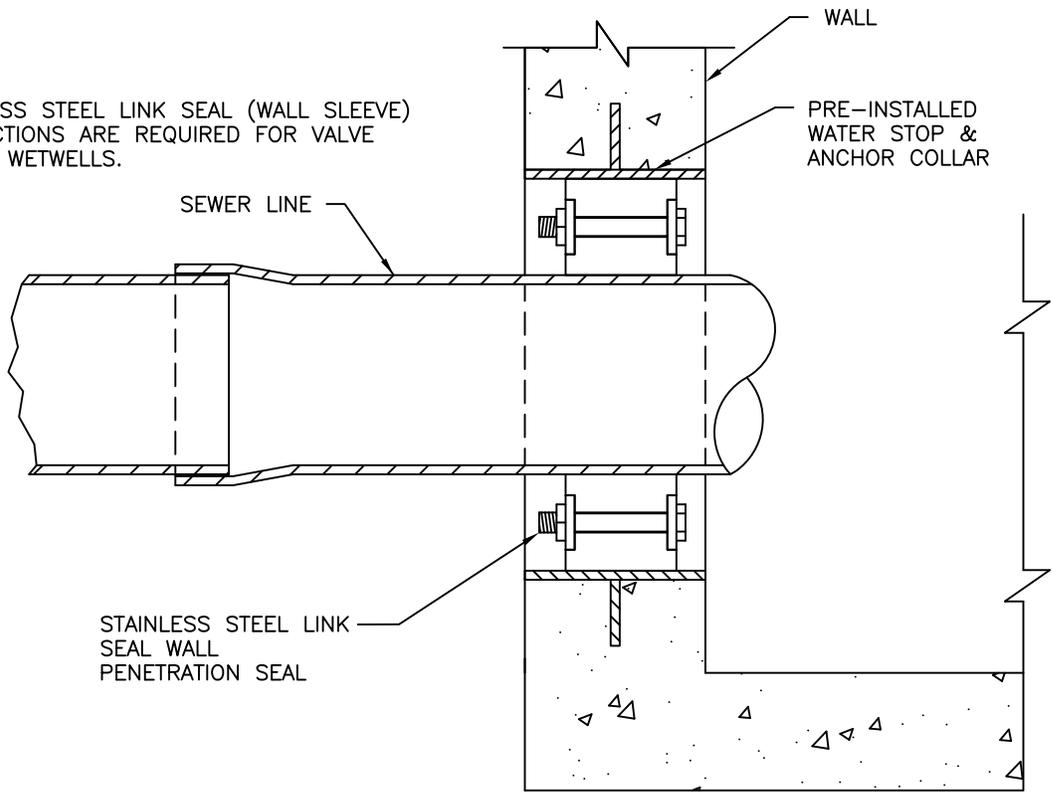


"LINK SEAL" CONNECTION

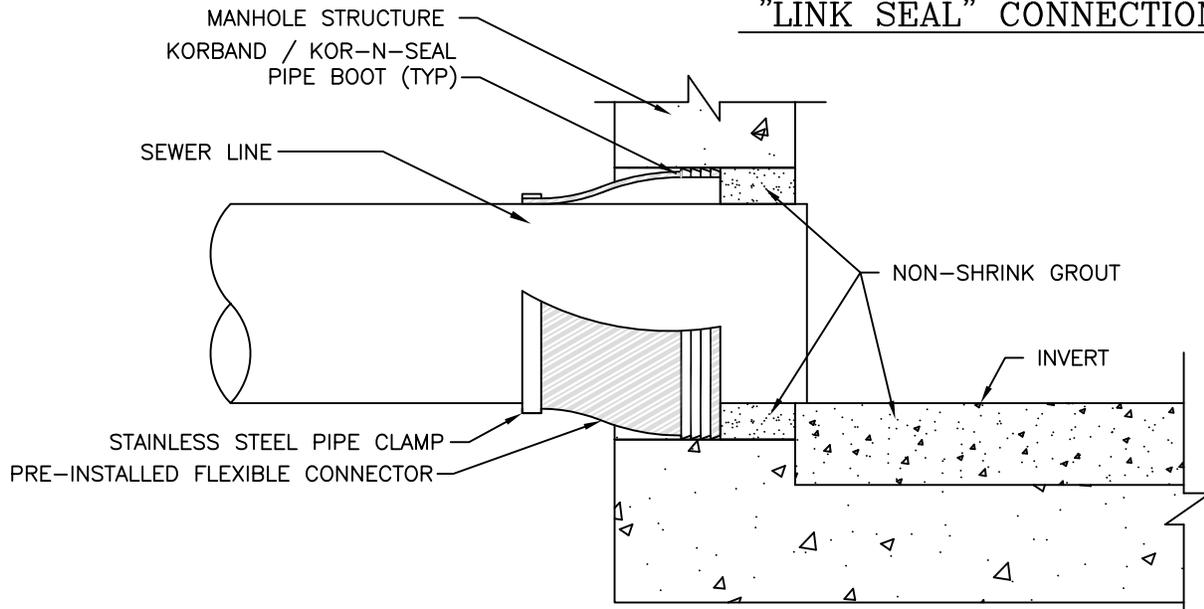

"BOOT" CONNECTION

PRECAST STRUCTURE PIPE CONNECTIONS

STANDARD
CONSTRUCTION
DETAILS



CITY OF
savannah

WATER RESOURCES AND PUBLIC WORKS BUREAU
Planning & Engineering

SCALE: N.T.S.

DATED: JAN 2017

PLATE NUMBER:

S12